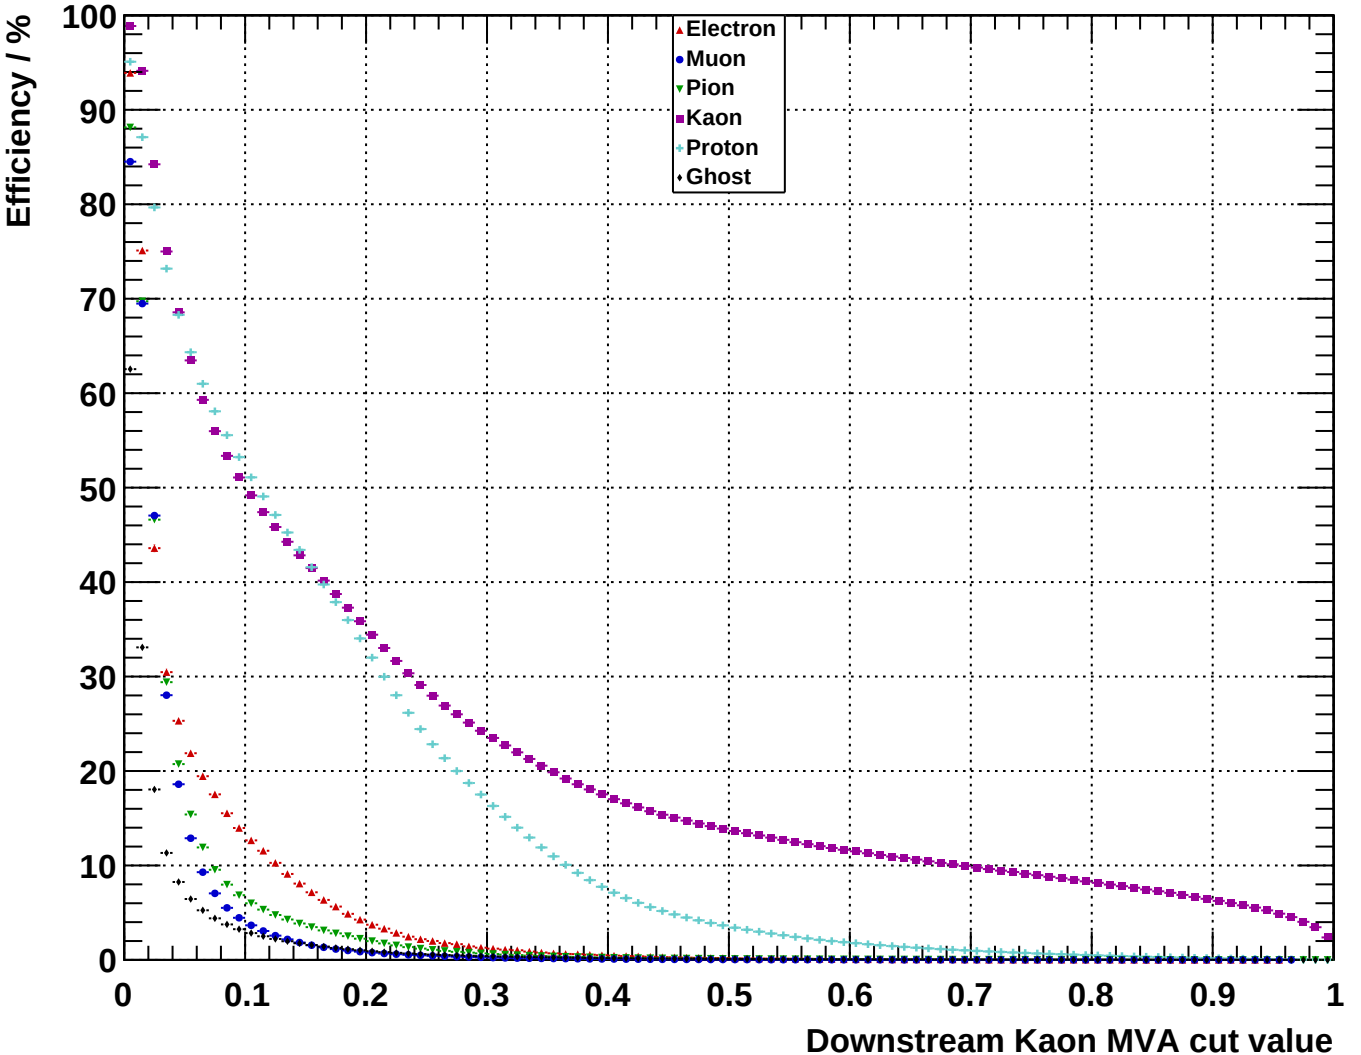MVAVDownstream Kaon Eff. V MVAcut | CombDLLk > -1.0000 | MLP Norm BP NCycles750 CE sigmoid HL1SF1.6 HL2SF1.2 CVTest15:1e-16 !UseReg
All NaturalMix AllPhysTracksInEvent:AllPhysTracksInEvent NoReweight EvalWithPreSel | Train:UpgradeSim09cUp02RecoUp01MixtureGhosts GhF0.1 PrF0.1 Eval:UpgradeSim09cUp02RecoUp01MixtureGhosts | TMVA-Upgrade-Sim09cUp02RecoUp01